


MEDIUM VOLTAGE R-RATED AMP-TRAP FUSE
 MINIMUM MELTING TIME CURRENT DATA
 2400/4800 VOLT 5.5KV MAX
 CAT. NO. A480R(2R-36R)-1, -1AB, -1HS & -1HE
 MERSEN
 NEWBURYPORT, MA 01950

280121

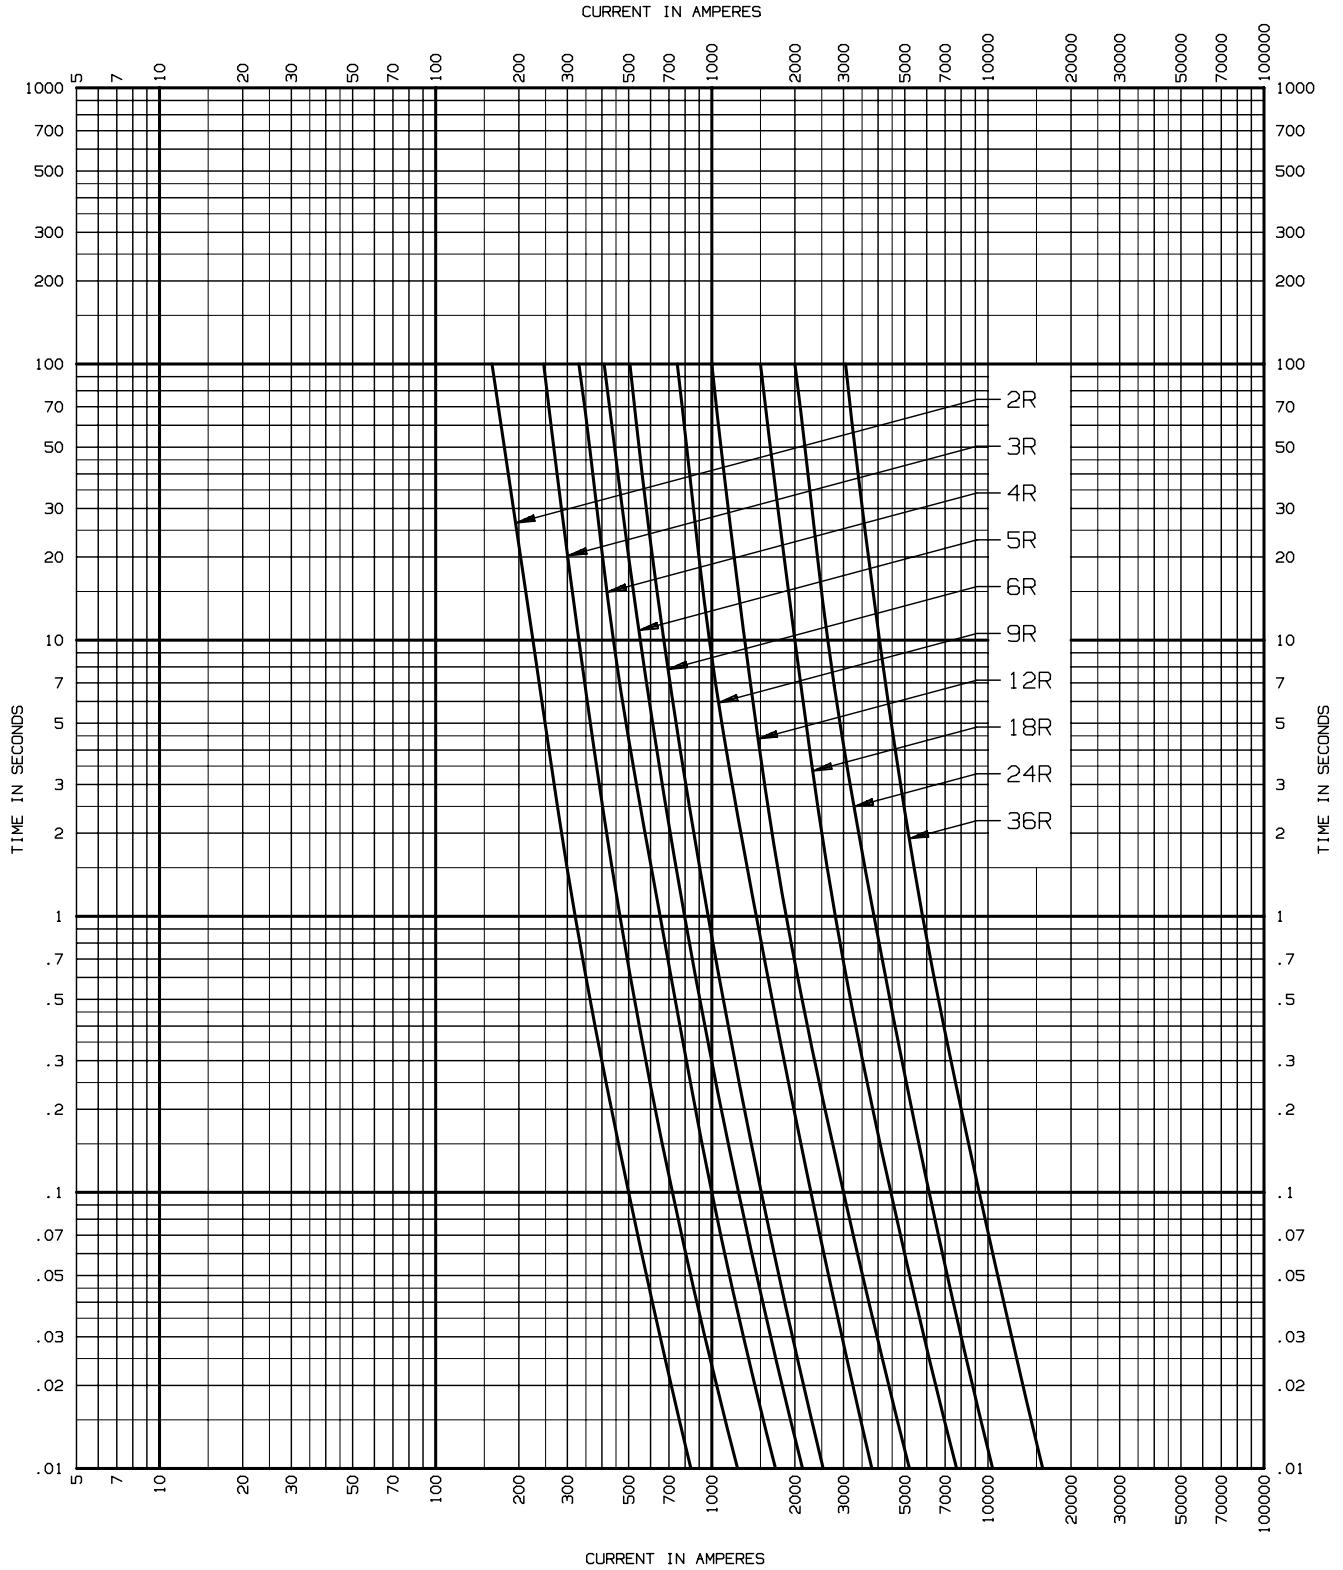

CONTROL NO: 1215
 FOLDER NO: 14B
 REV.: 1
 DATE: 7-14-10