

MEDIUM VOLTAGE R-RATED AMP-TRAP FUSE

CAT. NO. A240R(1-36)R


CS-3 2.6KV MAX.

PEAK LET-THRU CURVE

MERSEN

NEWBURYPORT, MA 01950

720506

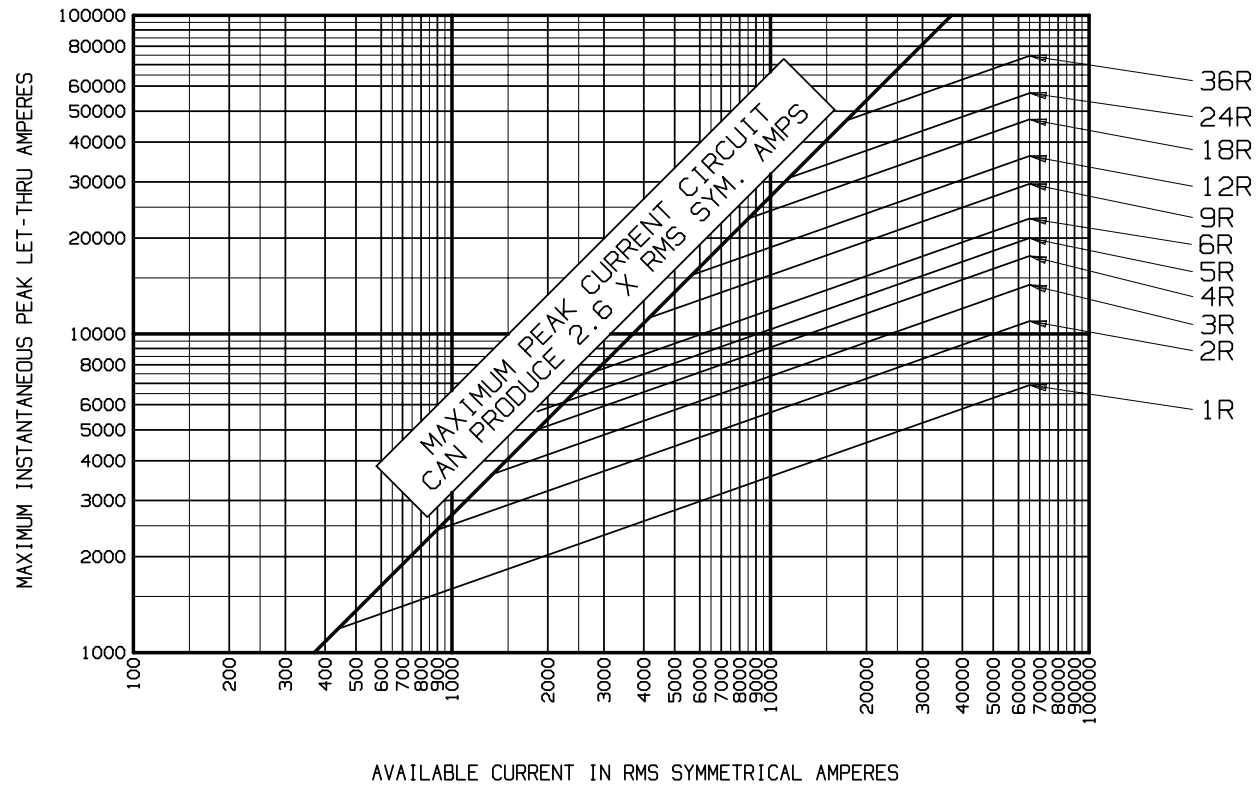

CONTROL NO: 1215  
FOLDER NO: 14B  
REV. C  
DATE: 7-14-10