


CABLE PROTECTOR AMP-TRAP FUSE
CL-14
A083C1D0R0-60E
60E 8.3KV
TOTAL CLEARING TIME CURRENT CURVE
FERRAZ SHAWMUT
NEWBURYPORT, MA 01950
720467

CURRENT IN AMPERES X10

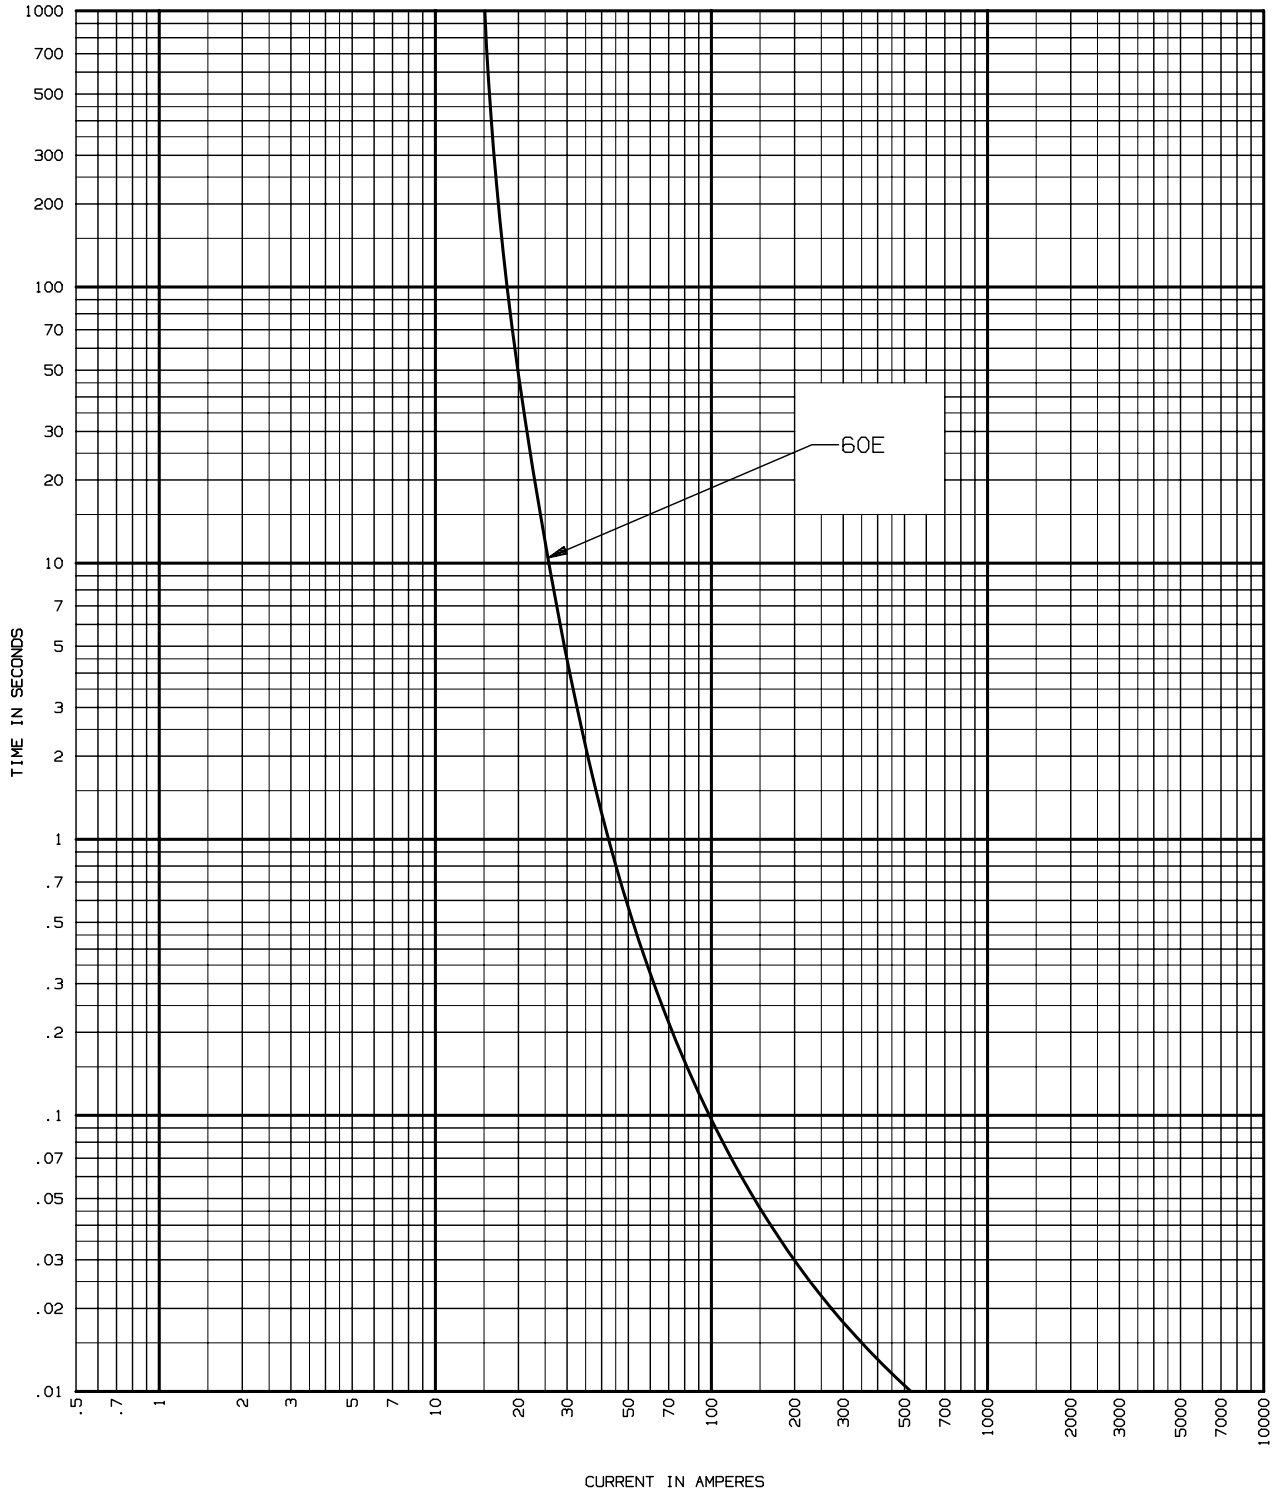

CONTROL No: 1190
FOLDER NO.: 14A
REV. A
2-13-08