


MEDIUM VOLTAGE R-RATED AMP-TRAP FUSE  
 TOTAL CLEARING TIME CURRENT DATA  
 2400/4800 VOLT 5.5KV MAX  
 CAT. NO. A480R(2R-36R)-1, -1AB, -1HS & -1HE  
 MERSEN  
 NEWBURYPORT, MA 01950  
 283121

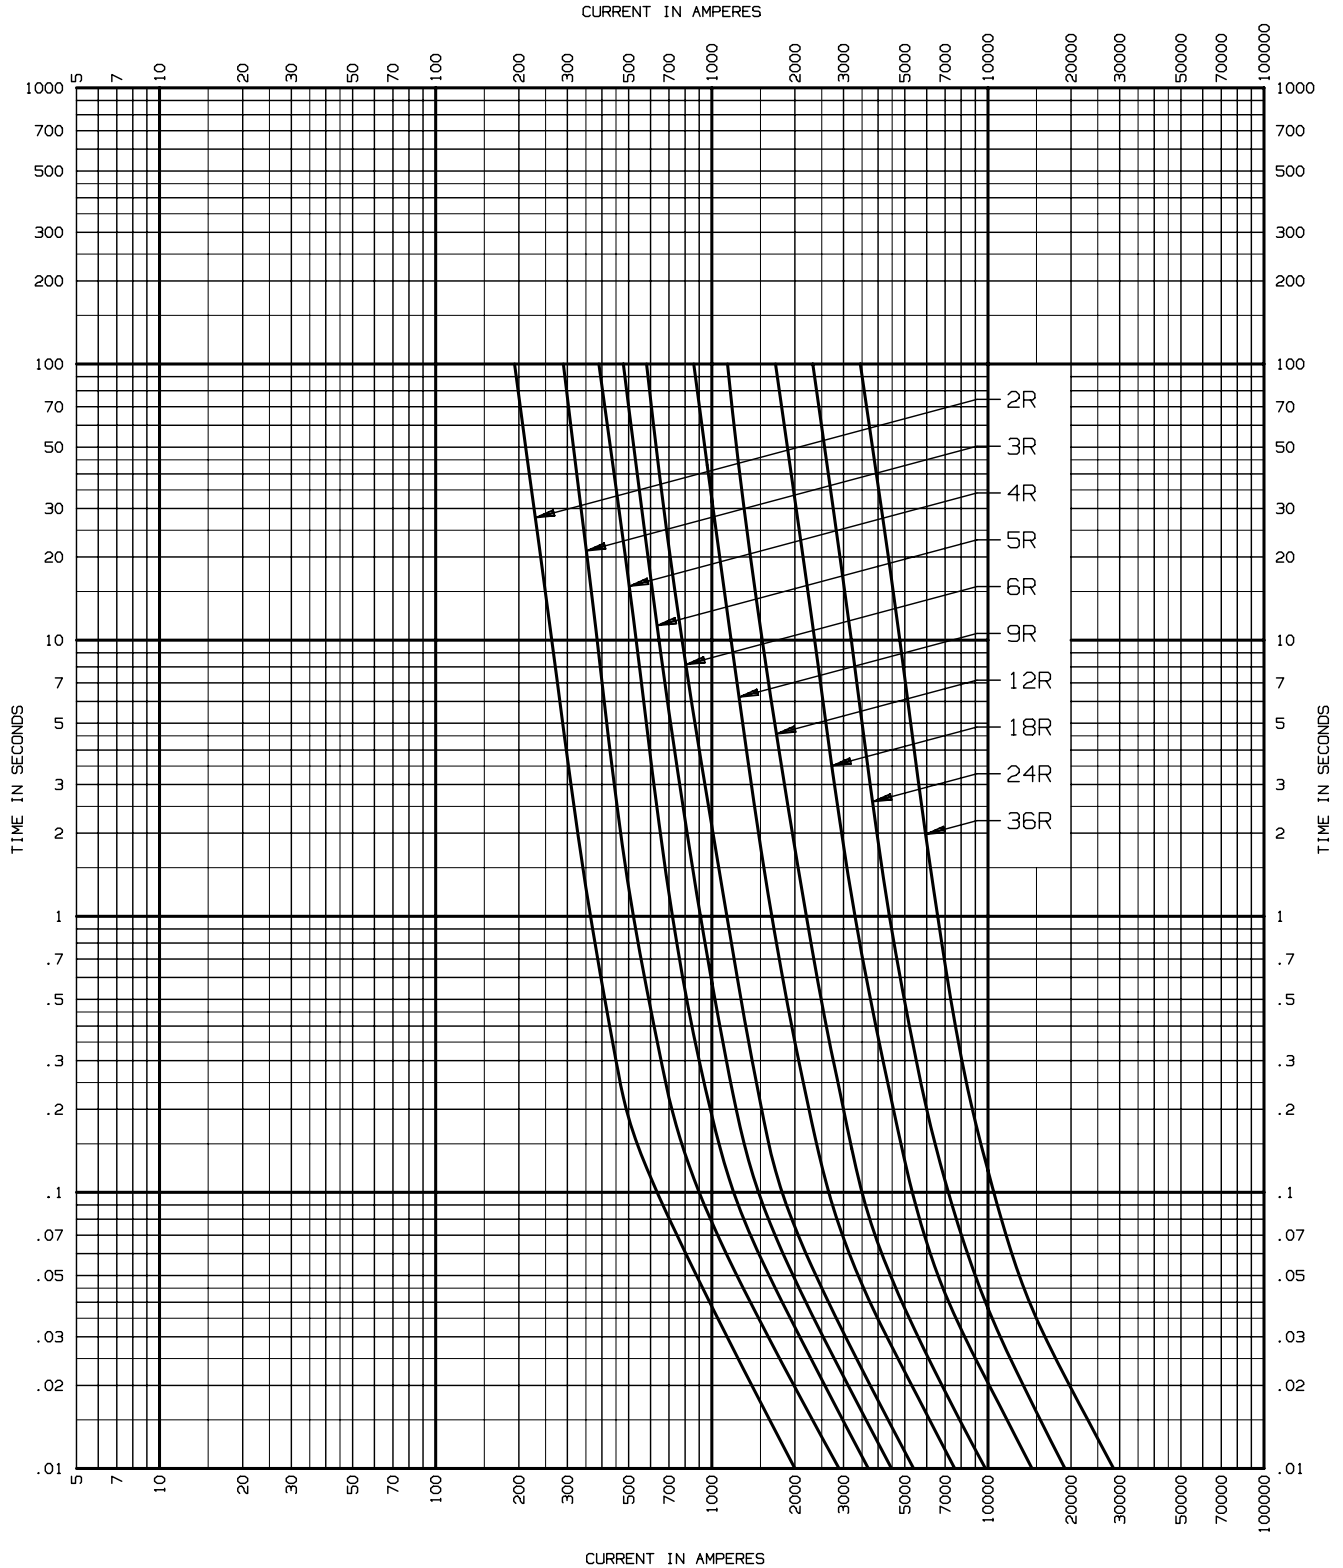

CONTROL NO: 1215  
 FOLDER NO: 14B  
 REV.: H  
 DATE: 7-14-10