


MEDIUM VOLTAGE AMP-TRAP FUSE  
CL-14  
A083C2D0R0-200E  
200E 8.3KV  
TOTAL CLEARING TIME CURRENT CURVE

**MERSEN**  
Newburyport, MA 01950  
720470

CURRENT IN AMPERES X10

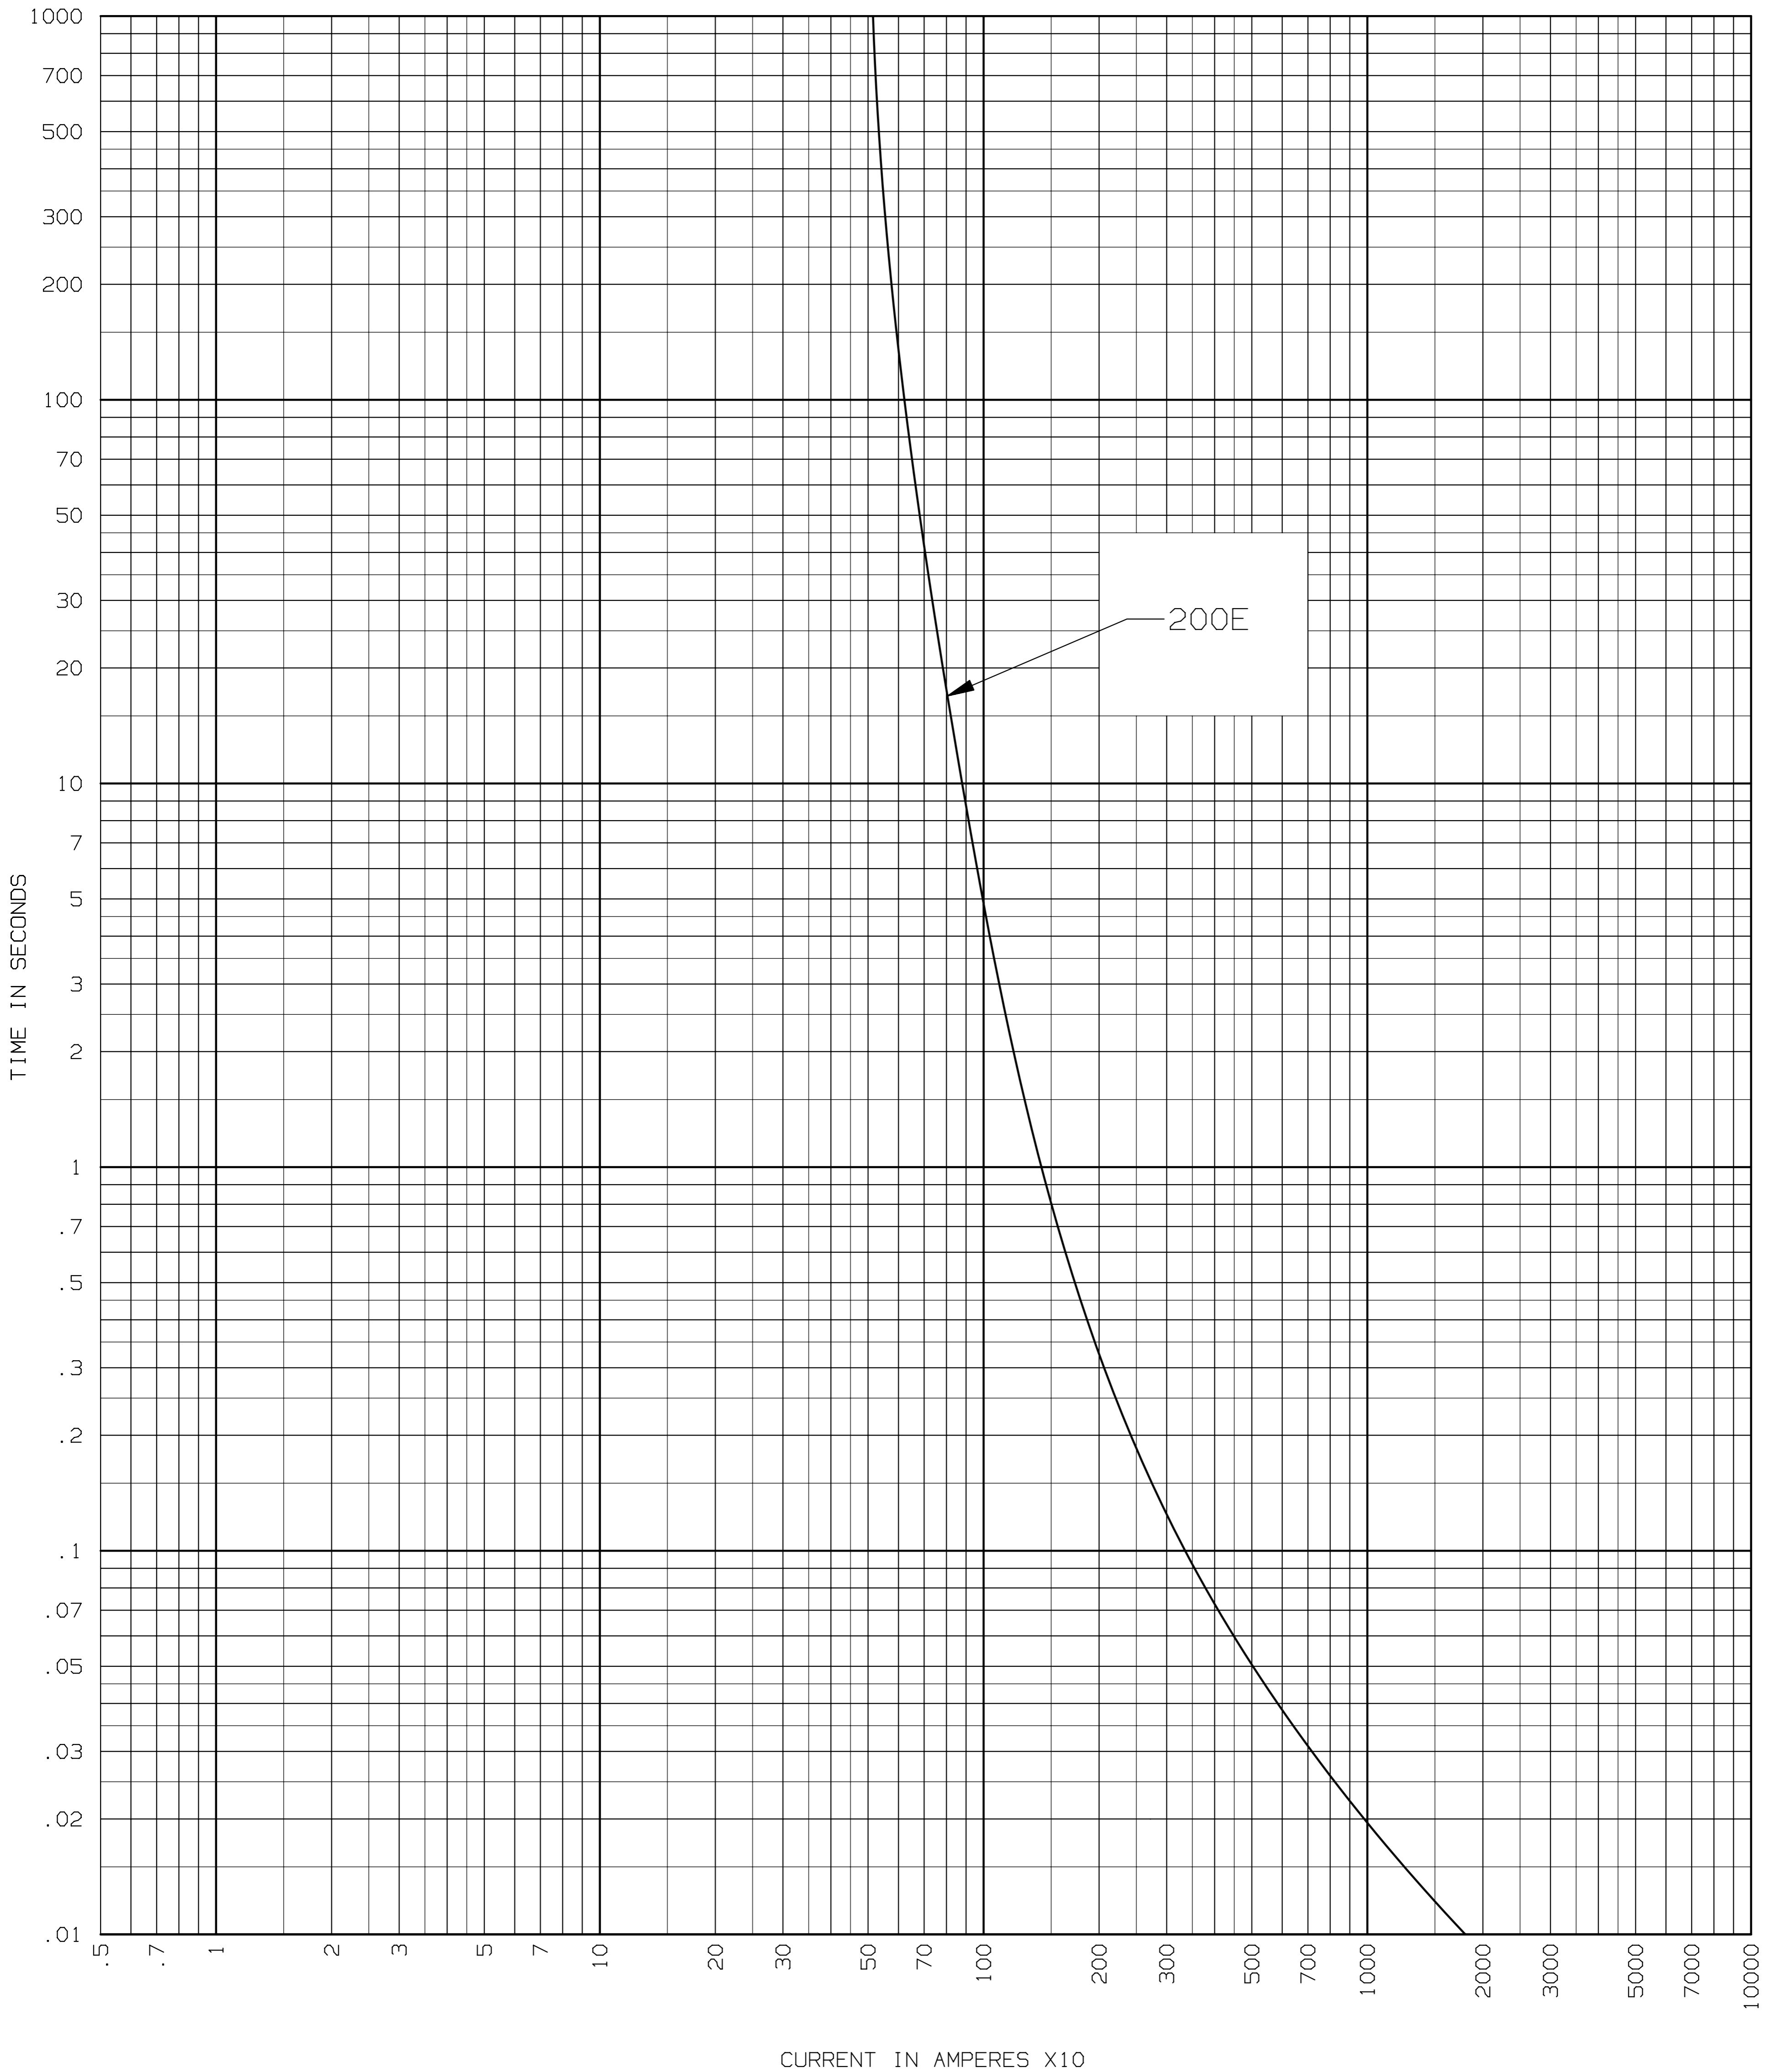

CURRENT IN AMPERES X10

CONTROL No: 1802  
FOLDER NO.: 14A  
REV. B  
6-17-16